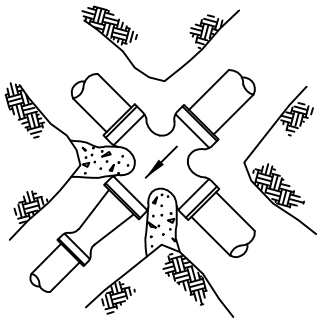

UNBALANCED CROSS

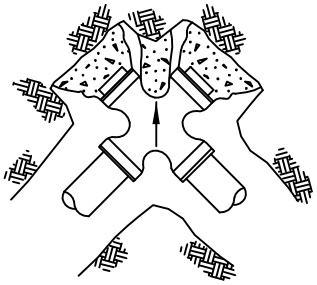

PLUGGED CROSS

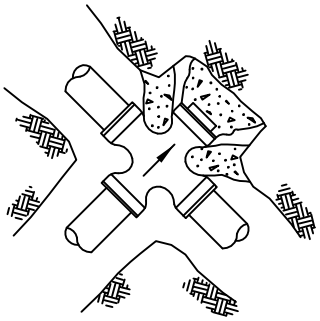

PLUGGED CROSS



PLUGGED TEE

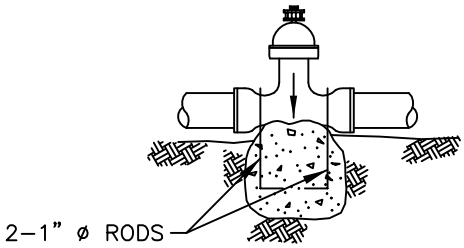

VALVE

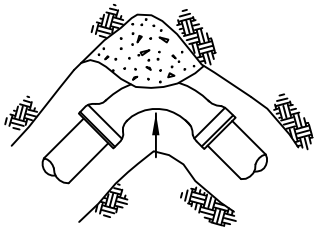

HORIZONTAL BEND

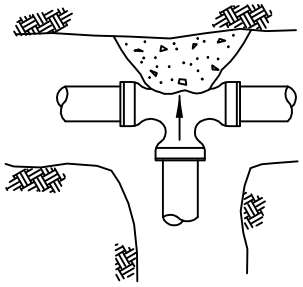

TEE

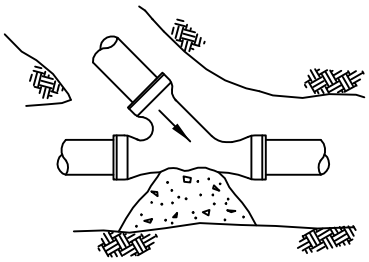

"Y" BRANCH

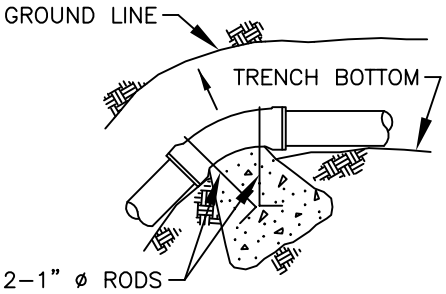

VERTICAL BEND

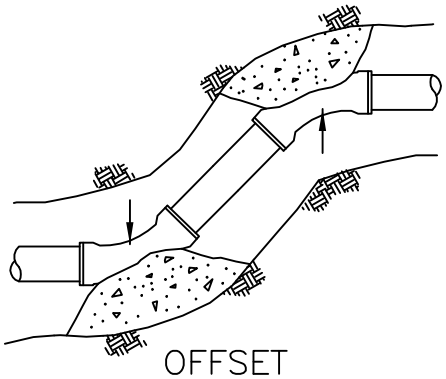

OFFSET

NOTES:

1. SIZE OF BLOCK TO BE A MINIMUM OF 18" THICK.
2. ALL BLOCKING TO BE ON UNDISTURBED MATERIAL.

City of DELTA

CITY of DELTA
360 MAIN STREET
DELTA, CO 81416

CONCRETE THRUST BLOCKING
FOR UNBALANCED FITTINGS

DATE: DEC. 1998 | SHEET W5 OF 24